Foundation Notes:

1.) minimum compressive strength of concrete shall be 2500 psi. design, mix & place concrete in accordance with ACI 318.

2.) reinforcing steel shall comply with ASTM A615 and shall have a yield strength of 60,000 psi.

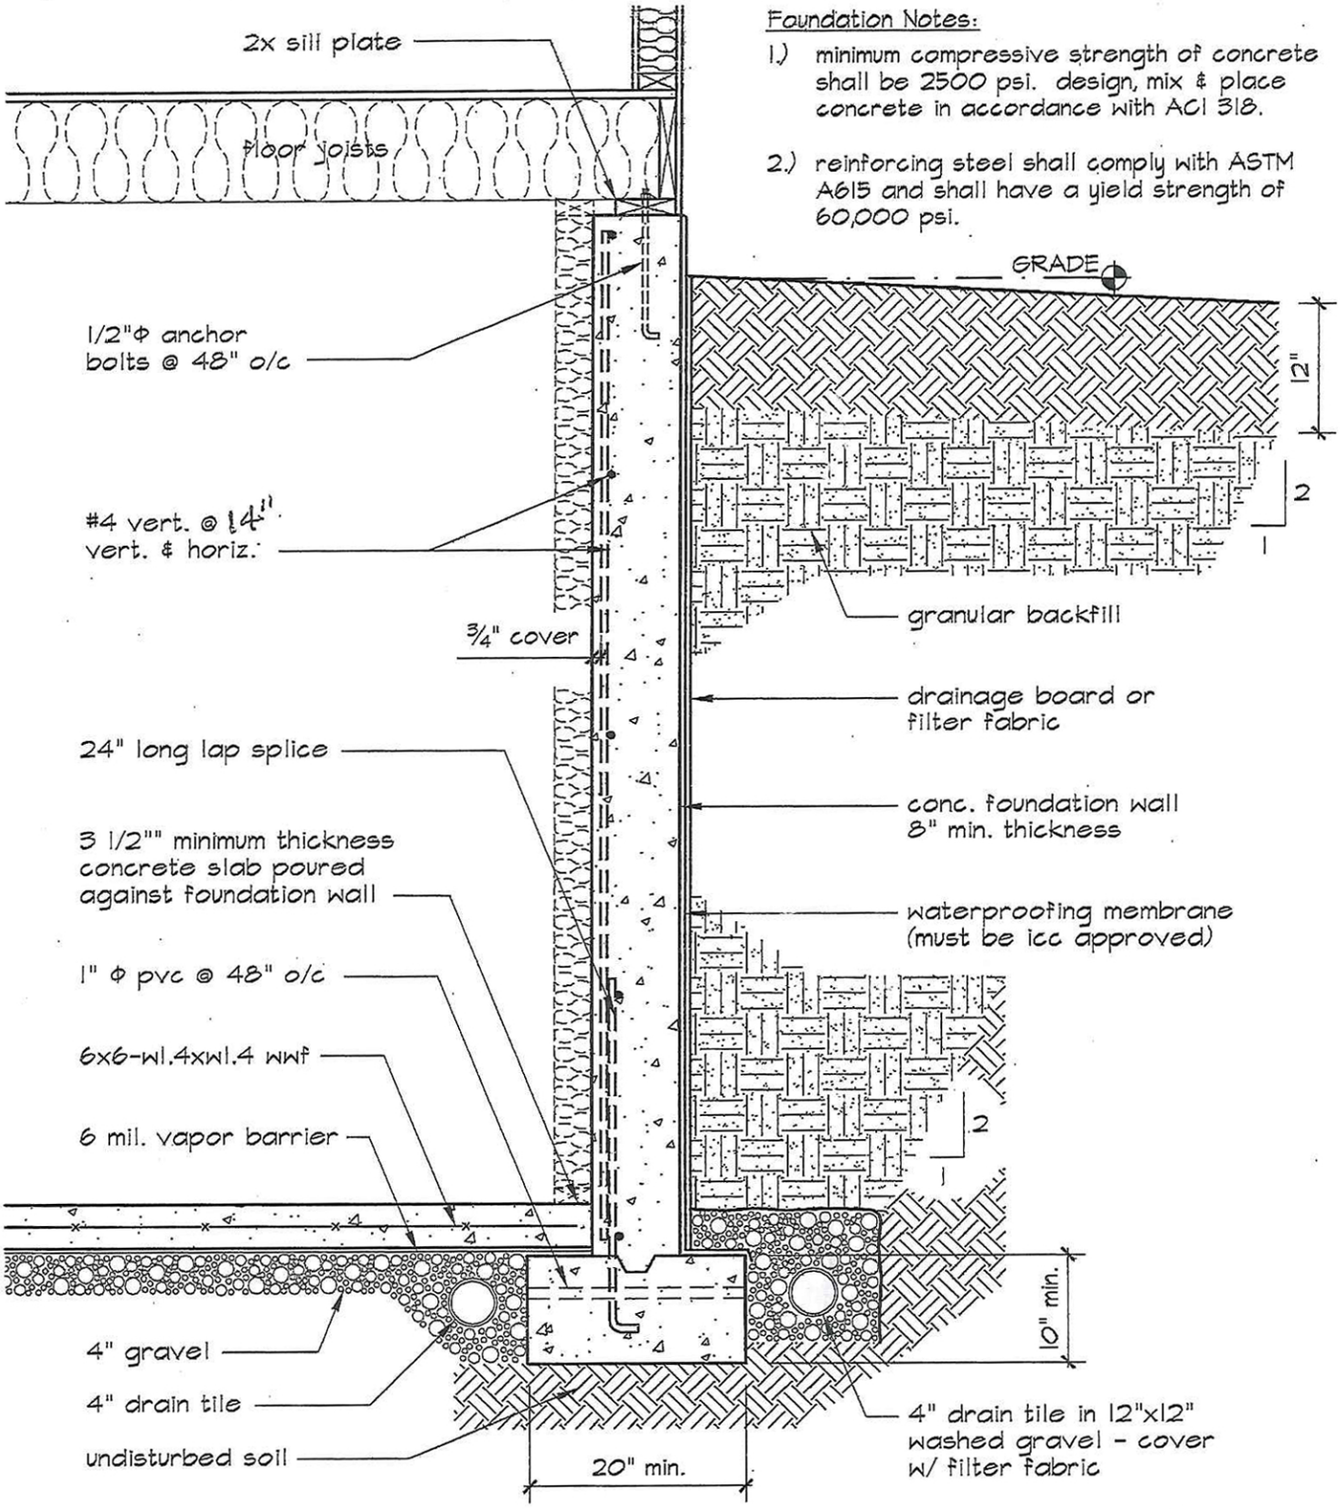

Insulation Note:
provide insulation between the floor joists (r=19 minimum) or basement wall insulation (r=13 cavity or r=11 continuous).

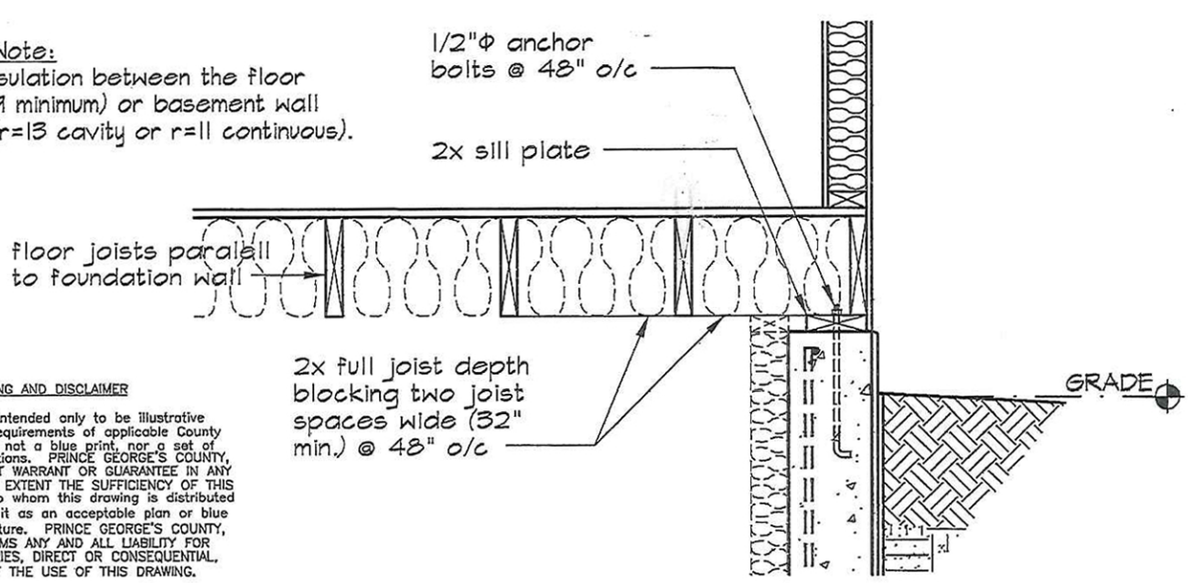

WARNING AND DISCLAIMER

This drawing is intended only to be illustrative of the minimum requirements of applicable County ordinances. It is not a blue print, nor a set of plans and specifications. PRINCE GEORGE'S COUNTY, MARYLAND DOES NOT WARRANT OR GUARANTEE IN ANY MANNER OR TO ANY EXTENT THE SUFFICIENCY OF THIS DRAWING. Persons to whom this drawing is distributed should not rely on it as an acceptable plan or blue print for any structure. PRINCE GEORGE'S COUNTY, MARYLAND DISCLAIMS ANY AND ALL LIABILITY FOR DAMAGES OR INJURIES, DIRECT OR CONSEQUENTIAL, ARISING OUT OF THE USE OF THIS DRAWING.

Drawing No.

D-110

Sheet 2 Of 2

BASEMENT WALL SECTION CONCRETE FOUNDATION

Prince George's County Government
Dept. of Permitting, Inspections and Enforcement